

**ebm-papst Mulfingen GmbH & Co. KG**

Bachmühle 2 · D-74673 Mulfingen

Phone +49 7938 81-0

Fax +49 7938 81-110

info1@de.ebmpapst.comwww.ebmpapst.com

Limited partnership · Headquarters Mulfingen

County court Stuttgart · HRA 590344

General partner Elektrobau Mulfingen GmbH · Headquarters Mulfingen

County court Stuttgart · HRB 590142

**Nominal data**

Type	G4D225-GK10-03		
Motor	M4D094-FA		
Phase		3~	3~
Nominal voltage	VAC	400	400
Connection		Y	Y
Frequency	Hz	50	60
Type of data definition		fa	ml
Valid for approval / standard		CE	CE
Speed	min ⁻¹	1310	1520
Power input	W	460	515
Current draw	A	0.85	0.9
Min. back pressure	Pa	0	200
Min. ambient temperature	°C	-40	-40
Max. ambient temperature	°C	75	60
Starting current	A	2.8	2.7

ml = Max. load · me = Max. efficiency · fa = Running at free air · cs = Customer specs · cu = Customer unit
Subject to alterations

Data according to ErP directive

Installation category	B
Efficiency category	Total
Variable speed drive	No
Specific ratio*	1.00

* Specific ratio = $1 + p_f / 100\,000\text{ Pa}$

		Actual	Request 2013	Request 2015
Overall efficiency η_e	%	40.3	31.4	38.4
Efficiency grade N		50.9	42	49
Power input P_e	kW	0.21		
Air flow q_v	m ³ /h	910		
Pressure increase p_f	Pa	340		
Speed n	min ⁻¹	1430		

Data definition with optimum efficiency.
The ErP data is determined using a motor-impeller combination in a standardised measurement configuration.

LU-56990




Technical features

Mass	10.8 kg
Size	225 mm
Surface of rotor	Coated in black
Material of impeller	Sheet steel, hot-galvanised
Housing material	Sheet steel, hot-galvanised
Direction of rotation	Clockwise, seen on rotor
Type of protection	IP 54
Insulation class	"F"
Humidity class	F4-1
Max. permissible ambient motor temp. (transp./ storage)	+ 80 °C
Min. permissible ambient motor temp. (transp./storage)	- 40 °C
Mounting position	Shaft horizontal or rotor on bottom; rotor on top on request
Condensate discharge holes	None
Operation mode	S1
Motor bearing	Ball bearing
Touch current acc. IEC 60990 (measuring network Fig. 4, TN system)	<= 3,5 mA
Motor protection	Thermal overload protector (TOP) brought out
Cable exit	Variable
Protection class	I (if protective earth is connected by customer)
Product conforming to standard	EN 60335-1
Approval	CCC; EAC

AC centrifugal fan

forward curved, single inlet
with housing (large flange)

Product drawing

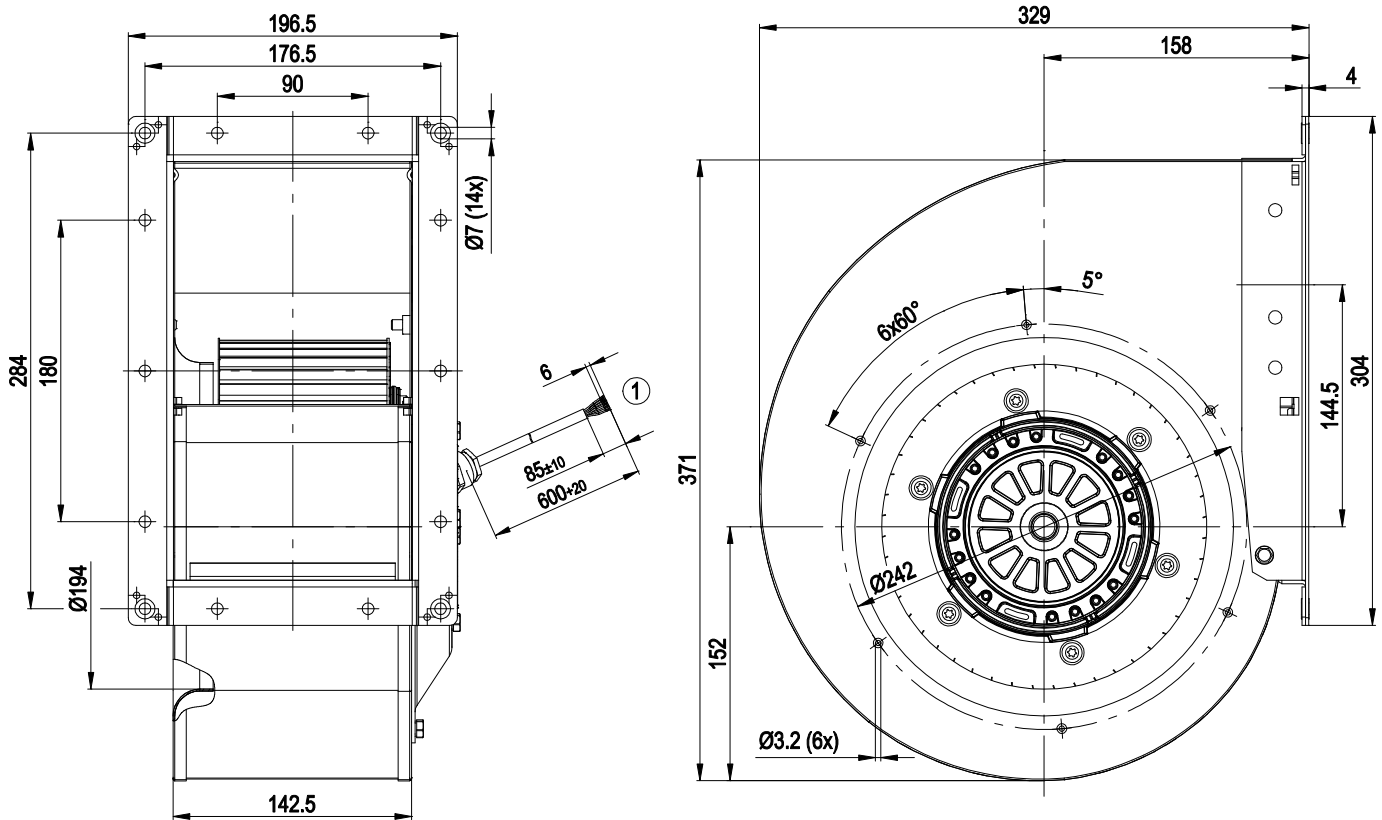


1 Connection line silicone, 6x brass lead tips crimped

AC centrifugal fan

forward curved, single inlet
with housing (large flange)

Connection screen

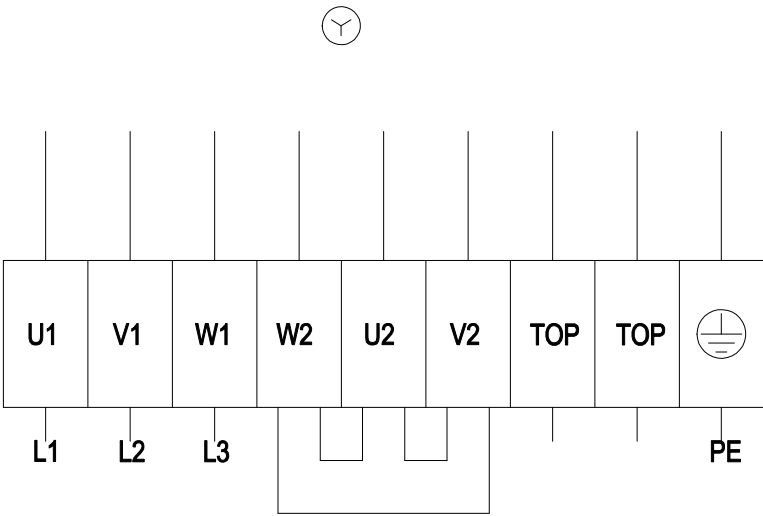


Y	Star connection	L1	= U1 = black	L2	= V1 = blue
L3	= W1 = brown	TOP	2 x grey	PE	green/yellow



AC centrifugal fan

forward curved, single inlet
with housing (large flange)

Charts: Air flow 50 Hz Y

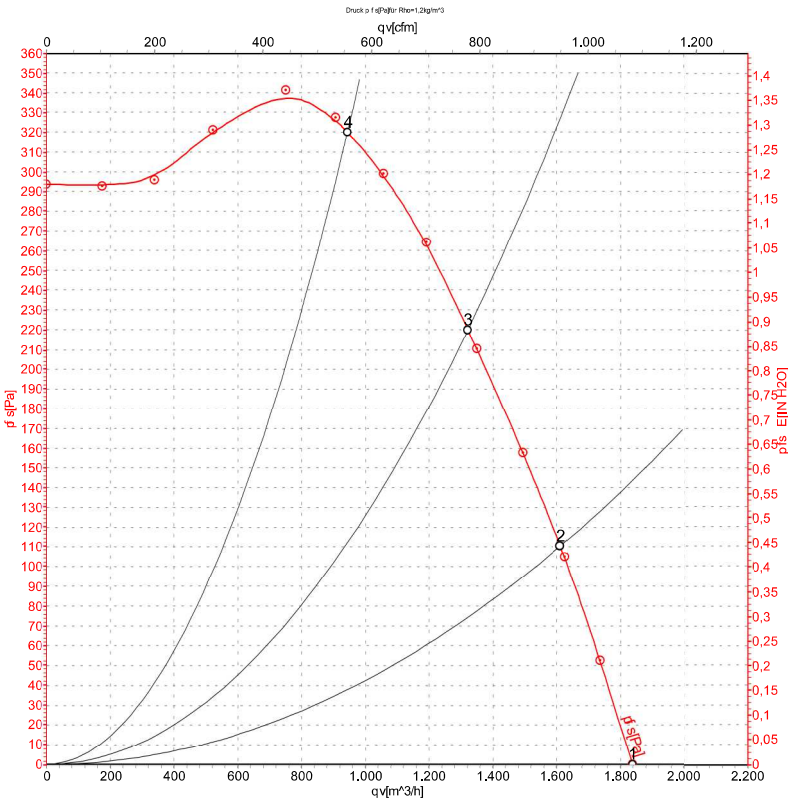

Measurement: LU-56990

Air performance measured as per ISO 5801
Installation category A. For detailed
information on the measuring set-up, please
contact ebm-papst. Suction-side noise
levels: L_{wA} measured as per ISO 13347 /
L_{pA} measured with 1m distance to fan axis.
The values given are valid under the
measuring conditions mentioned above and
may vary according to the actual installation
situation. With any deviation from the
standard set-up, the specific values have to
be checked and reviewed with the unit
installed.

Measured values

	Conn.	U	f	n	P _e	I	qv	p _{fs}
		V	Hz	min ⁻¹	W	A	m³/h	Pa
1	Y	400	50	1310	460	0.85	1835	0
2	Y	400	50	1350	385	0.76	1610	110
3	Y	400	50	1390	304	0.67	1320	220
4	Y	400	50	1425	219	0.60	945	320


Conn. = Connection · U = Supply voltage · f = Frequency · n = Speed · P_e = Power input · I = Current draw · qv = Air flow · p_{fs} = Pressure increase



AC centrifugal fan

forward curved, single inlet
with housing (large flange)

Charts: Air flow 60 Hz Y

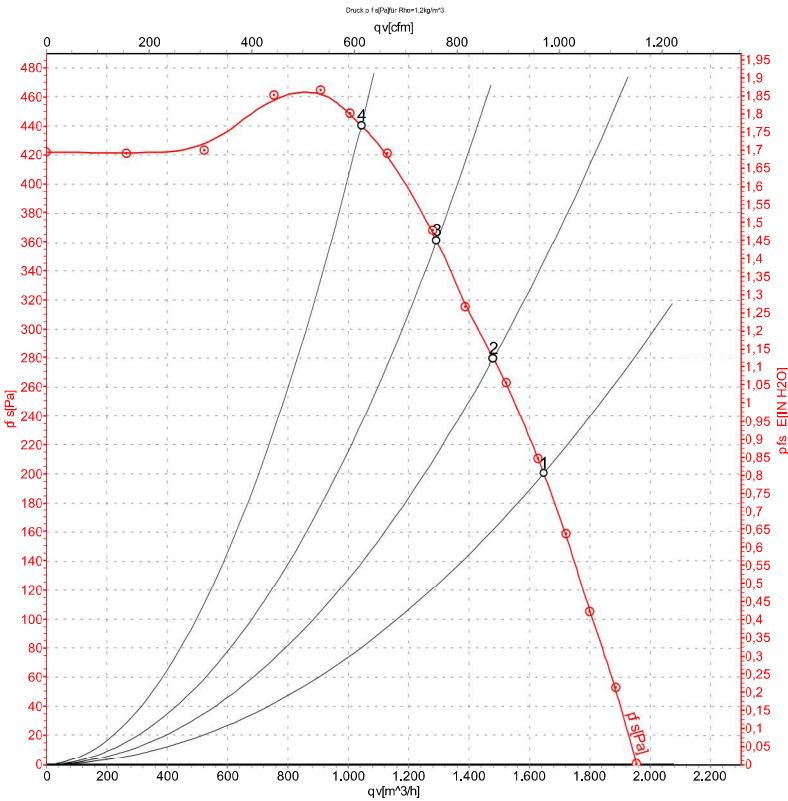

Measurement: LU-56991

Air performance measured as per ISO 5801
Installation category A. For detailed
information on the measuring set-up, please
contact ebm-papst. Suction-side noise
levels: L_{wA} measured as per ISO 13347 /
L_{pA} measured with 1m distance to fan axis.
The values given are valid under the
measuring conditions mentioned above and
may vary according to the actual installation
situation. With any deviation from the
standard set-up, the specific values have to
be checked and reviewed with the unit
installed.

Measured values

	Conn.	U	f	n	P _e	I	qv	p _{ts}
		V	Hz	min ⁻¹	W	A	m³/h	Pa
1	Y	400	60	1520	515	0.90	1645	200
2	Y	400	60	1555	466	0.82	1480	280
3	Y	400	60	1605	390	0.70	1290	360
4	Y	400	60	1655	312	0.60	1040	440

Conn. = Connection · U = Supply voltage · f = Frequency · n = Speed · P_e = Power input · I = Current draw · qv = Air flow · p_{ts} = Pressure increase

